


Load Test Result (MCS)

Site Name Energic Plus Concept
 Site Code Laborator
 Province Ag

Test Date 3/3/2017 2:28:30 PM
 Test Time 34:53:14 / 54:00:00
 MCS NO. 72014

Brand	Trojan T105	Volt.	4x6	Ah	207 @10H	Cells	12	Standby Volt.	25.2	Type	PlumbAcid	Year/Manuf.	15.03.2011 M.L.1-st Shift	Ambient Temp.	17,5
-------	-------------	-------	-----	----	----------	-------	----	---------------	------	------	-----------	-------------	------------------------------	---------------	------

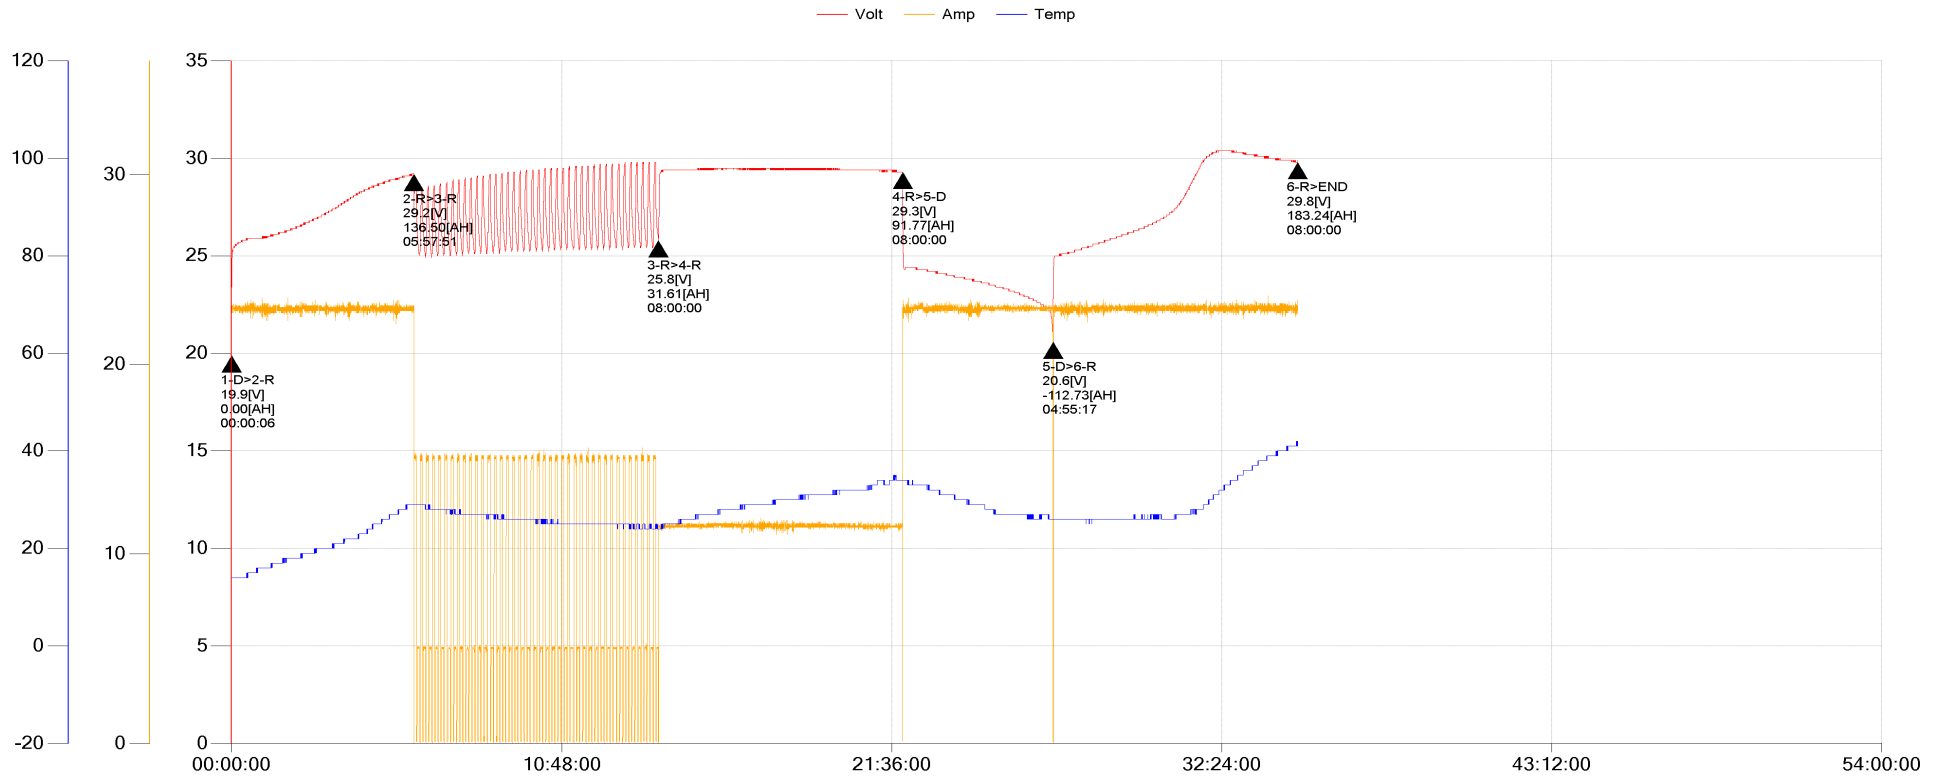

Index	Method	Pulse	Setup Time	Elapsed Time	Setup Volt	Max Volt	Min Volt	Setup Amp	AH	Temperature
1	Discharge	1	12:00:00	00:00:06	20.0	20.2	19.9	22.8	0.0	+014
2	Restoration	1	06:00:00	05:57:51	29.2	29.2	20.1	22.8	136.5	+029
3	Restoration	4	08:00:00	08:00:00	31.2	29.8	24.9	15.0	31.6	+024
4	Restoration	2	08:00:00	08:00:00	31.2	29.5	25.9	11.4	91.8	+034
5	Discharge	1	12:00:00	04:55:17	20.6	28.2	20.6	22.8	-112.7	+026
6	Restoration	2	08:00:00	08:00:00	31.2	30.4	22.6	22.8	183.2	+042

34:53:14