


Load Test Result (MCS)

Site Name Energic Plus Concept
 Site Code Laborator
 Province Ag

Test Date No date from filename
 Test Time 35:36:19 / 54:00:00
 MCS NO. 72014

Brand	Hawker	Volt.	24	Ah	240	Cells	12	Standby Volt.	25.2	Type	Pc-Ac	Year/Manuf.	05.05.2009	Ambient Temp.	18
-------	--------	-------	----	----	-----	-------	----	---------------	------	------	-------	-------------	------------	---------------	----

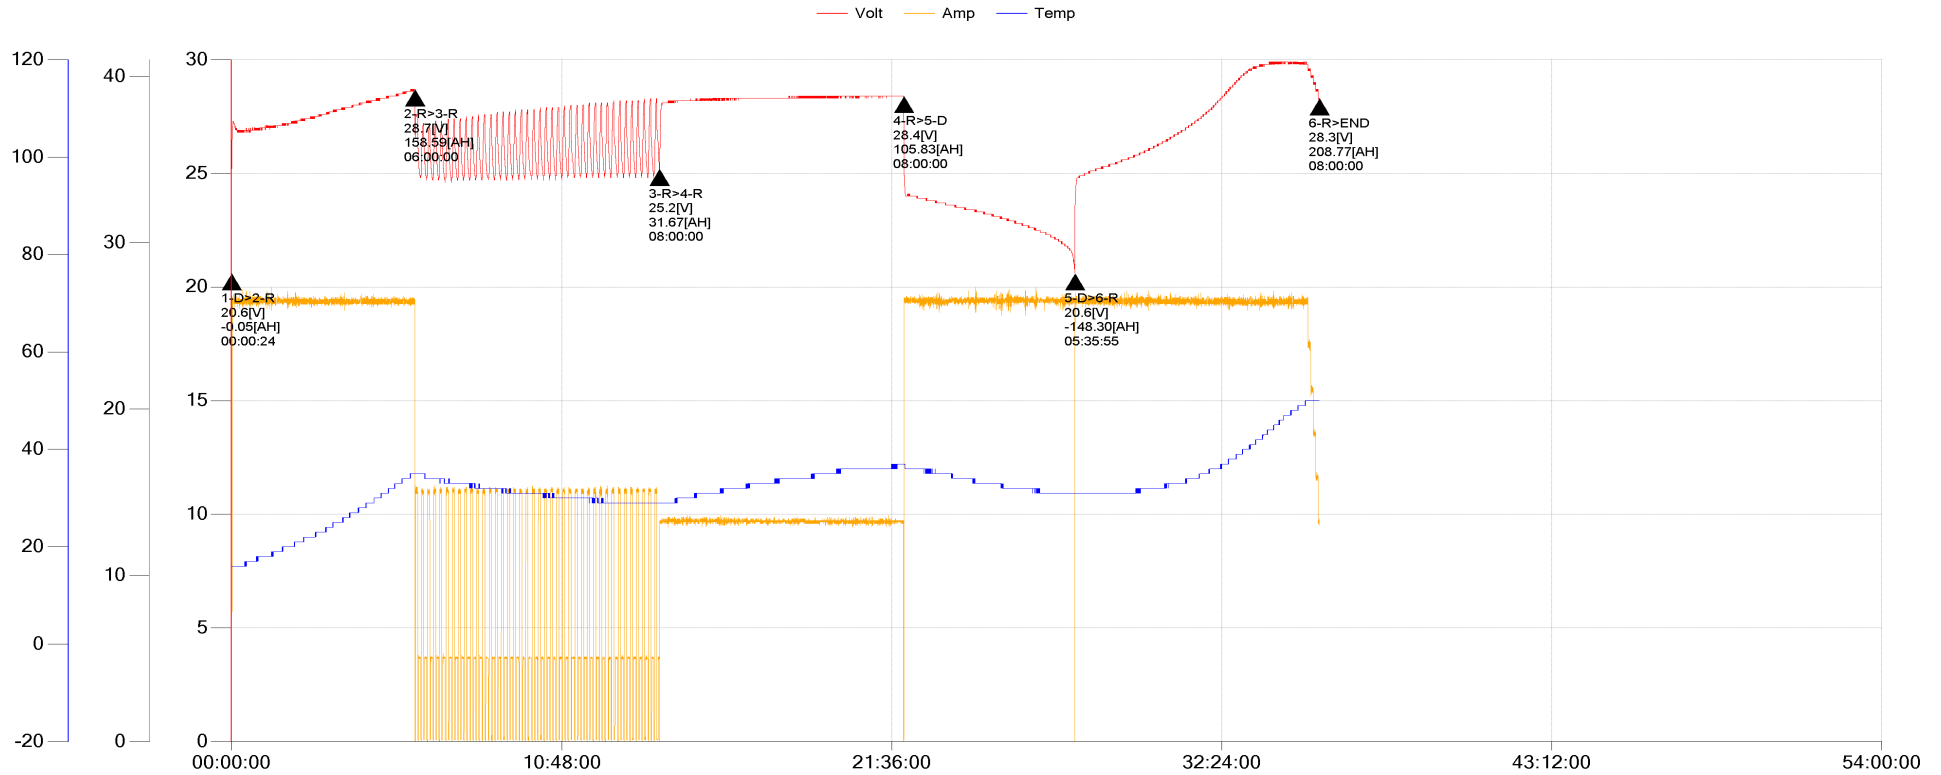

Index	Method	Pulse	Setup Time	Elapsed Time	Setup Volt	Max Volt	Min Volt	Setup Amp	AH	Temperature
1	Discharge	1	12:00:00	00:00:24	20.6	22.7	20.6	26.4	0.0	+016
2	Restoration	1	06:00:00	06:00:00	29.2	28.7	22.3	26.4	158.6	+035
3	Restoration	4	08:00:00	08:00:00	31.2	28.3	24.6	15.0	31.7	+029
4	Restoration	2	08:00:00	08:00:00	31.2	28.4	25.3	13.2	105.8	+037
5	Discharge	1	12:00:00	05:35:55	20.6	27.5	20.6	26.4	-148.3	+031
6	Restoration	2	08:00:00	08:00:00	31.2	29.9	22.2	26.4	208.8	+050

35:36:19