


Load Test Result (MCS)

Site Name Energic Plus Concept
 Site Code Laborator
 Province Ag

Test Date 7/21/2017 6:51:16 PM
 Test Time 47:04:25 / 54:00:00
 MCS NO. 72014

Brand	ISKRA	Volt.	24	Ah	240	Cells	12	Standby Volt.	26.1	Type	Pb-Ac	Year/Manuf.	2006	Ambient Temp.	27
-------	-------	-------	----	----	-----	-------	----	---------------	------	------	-------	-------------	------	---------------	----

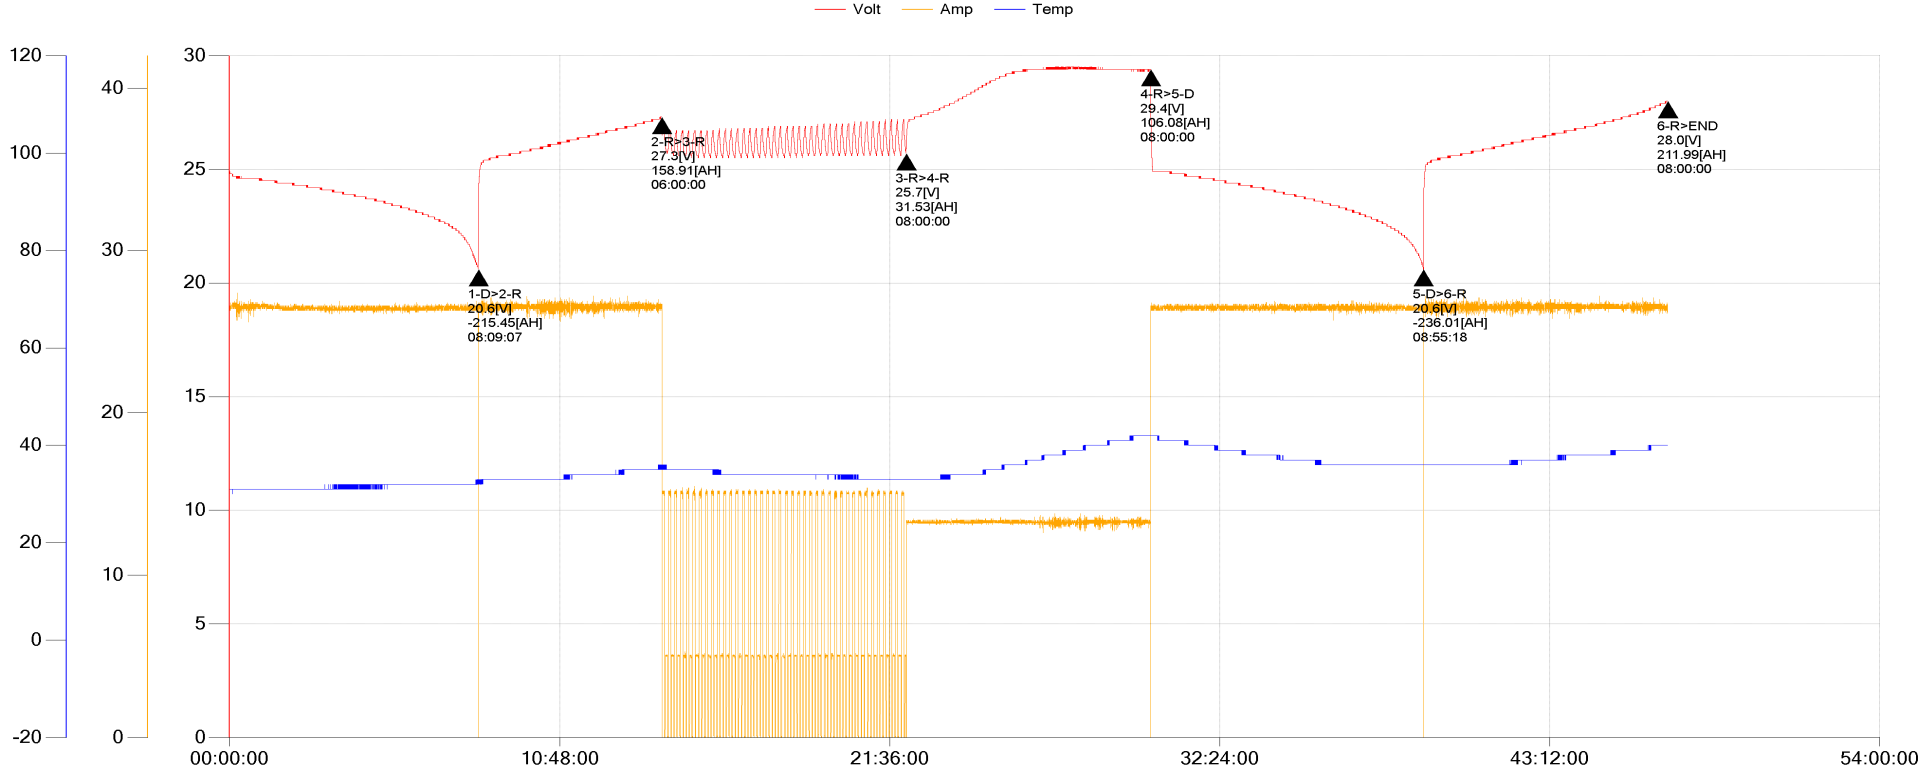

Index	Method	Pulse	Setup Time	Elapsed Time	Setup Volt	Max Volt	Min Volt	Setup Amp	AH	Temperature
1	Discharge	1	12:00:00	08:09:07	20.6	25.8	20.6	26.4	-215.5	+033
2	Restoration	1	06:00:00	06:00:00	29.2	27.3	22.5	26.4	158.9	+036
3	Restoration	4	08:00:00	08:00:00	31.2	27.2	25.5	15.0	31.5	+033
4	Restoration	2	08:00:00	08:00:00	31.2	29.5	25.9	13.2	106.1	+042
5	Discharge	1	12:00:00	08:55:18	20.6	28.5	20.6	26.4	-236.0	+036
6	Restoration	2	08:00:00	08:00:00	31.2	28.0	22.4	26.4	212.0	+040
47:04:25										