


Load Test Result (MCS)

Site Name _____
 Site Code _____
 Province _____

Test Date 10/18/2016 12:58:55 PM
 Test Time 36:56:06 / 53:00:00
 MCS NO. _____

Brand		Volt.	46V	Ah	625	Cells	23	Standby Volt.		Type		Year/Manuf.		Ambient Temp.	
-------	--	-------	-----	----	-----	-------	----	---------------	--	------	--	-------------	--	---------------	--

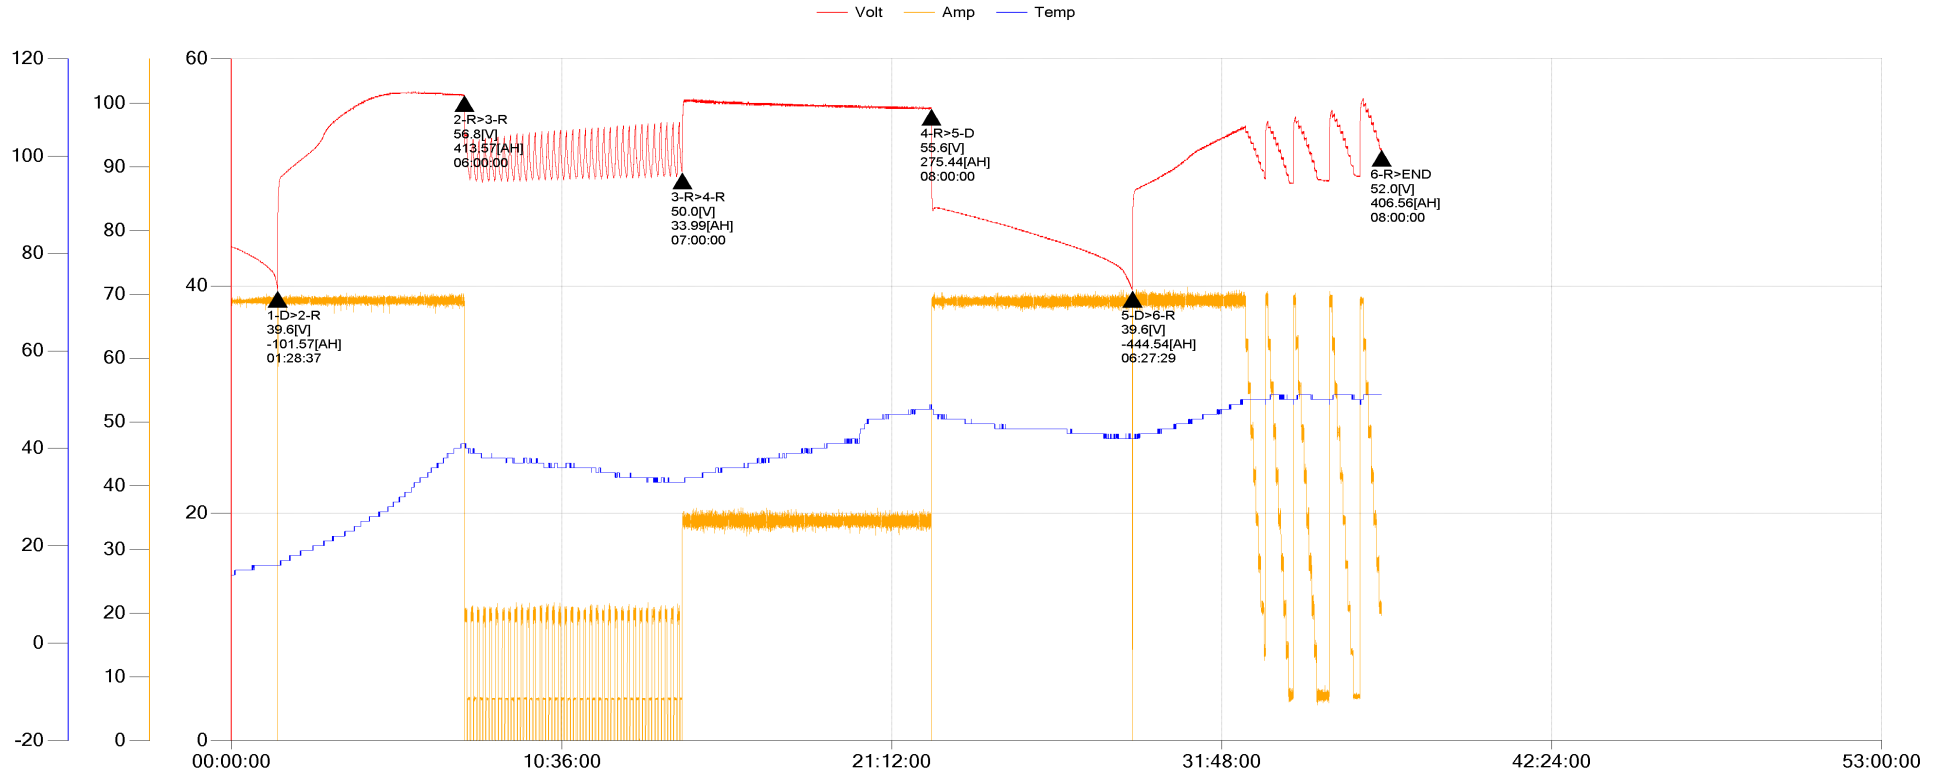

Index	Method	Pulse	Setup Time	Elapsed Time	Setup Volt	Max Volt	Min Volt	Setup Amp	AH	Temperature
1	Discharge	1	12:00:00	01:28:37	39.6	46.3	39.6	68.8	-101.6	+016
2	Restoration	1	06:00:00	06:00:00	57.8	57.1	43.1	68.8	413.6	+041
3	Restoration	4	07:00:00	07:00:00	59.8	54.4	49.1	19.6	34.0	+033
4	Restoration	2	08:00:00	08:00:00	59.8	56.5	50.2	34.4	275.4	+049
5	Discharge	1	12:00:00	06:27:29	39.6	53.6	39.6	68.8	-444.5	+042
6	Restoration	2	08:00:00	08:00:00	59.8	56.5	43.1	68.8	406.6	+051

36:56:06

