


# Load Test Result (MCS)

Site Name Delta Invest  
 Site Code D.I.  
 Province Arges

Test Date 11/18/2016 4:45:50 PM  
 Test Time 34:21:50 / 53:30:00  
 MCS NO. Energic Plus Concept

Brand	4x Trojan T105	Volt.	24	Ah	207	Cells	4	Standby Volt.	24.6	Type	Lead Acid	Year/Manuf.	unkn.	Ambient Temp.	15
-------	----------------	-------	----	----	-----	-------	---	---------------	------	------	-----------	-------------	-------	---------------	----

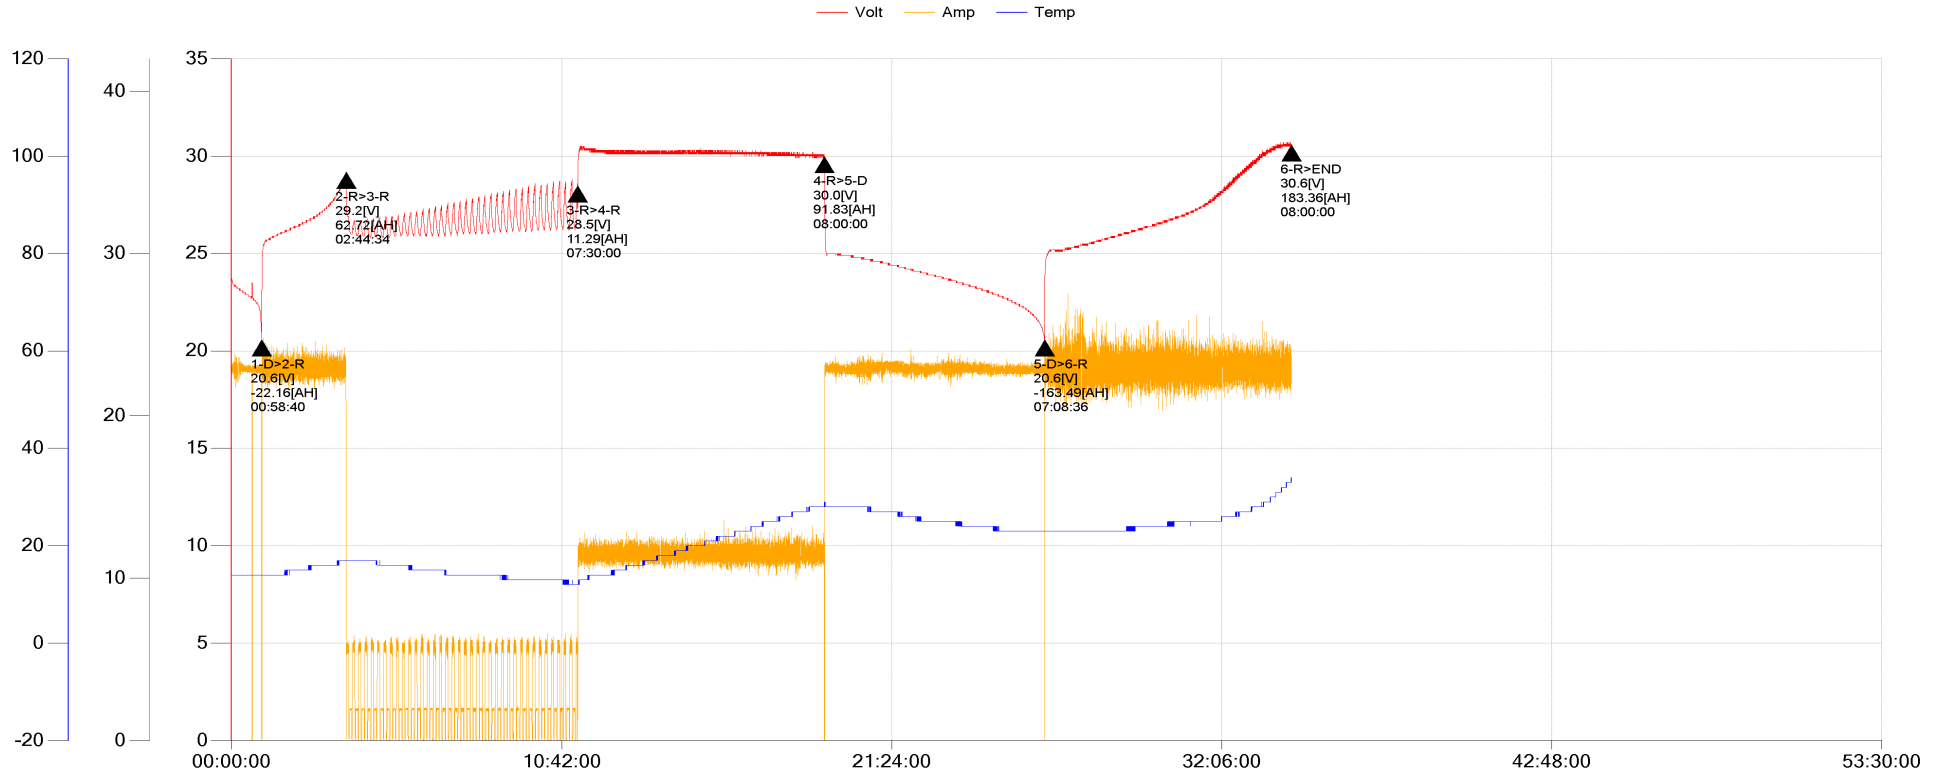

Index	Method	Pulse	Setup Time	Elapsed Time	Setup Volt	Max Volt	Min Volt	Setup Amp	AH	Temperature
1	Discharge	1	12:00:00	00:58:40	20.6	24.6	20.6	22.8	-22.2	+014
2	Restoration	1	06:00:00	02:44:34	29.2	29.2	22.6	22.8	62.7	+017
3	Restoration	4	07:30:00	07:30:00	31.2	28.8	25.8	5.7	11.3	+012
4	Restoration	2	08:00:00	08:00:00	31.2	30.5	27.3	11.4	91.8	+029
5	Discharge	1	12:00:00	07:08:36	20.6	28.9	20.6	22.8	-163.5	+023
6	Restoration	2	08:00:00	08:00:00	31.2	30.7	21.8	22.8	183.4	+033

34:21:50